


**TEMPORARY METER POLE  
SIX MONTH LIMIT**

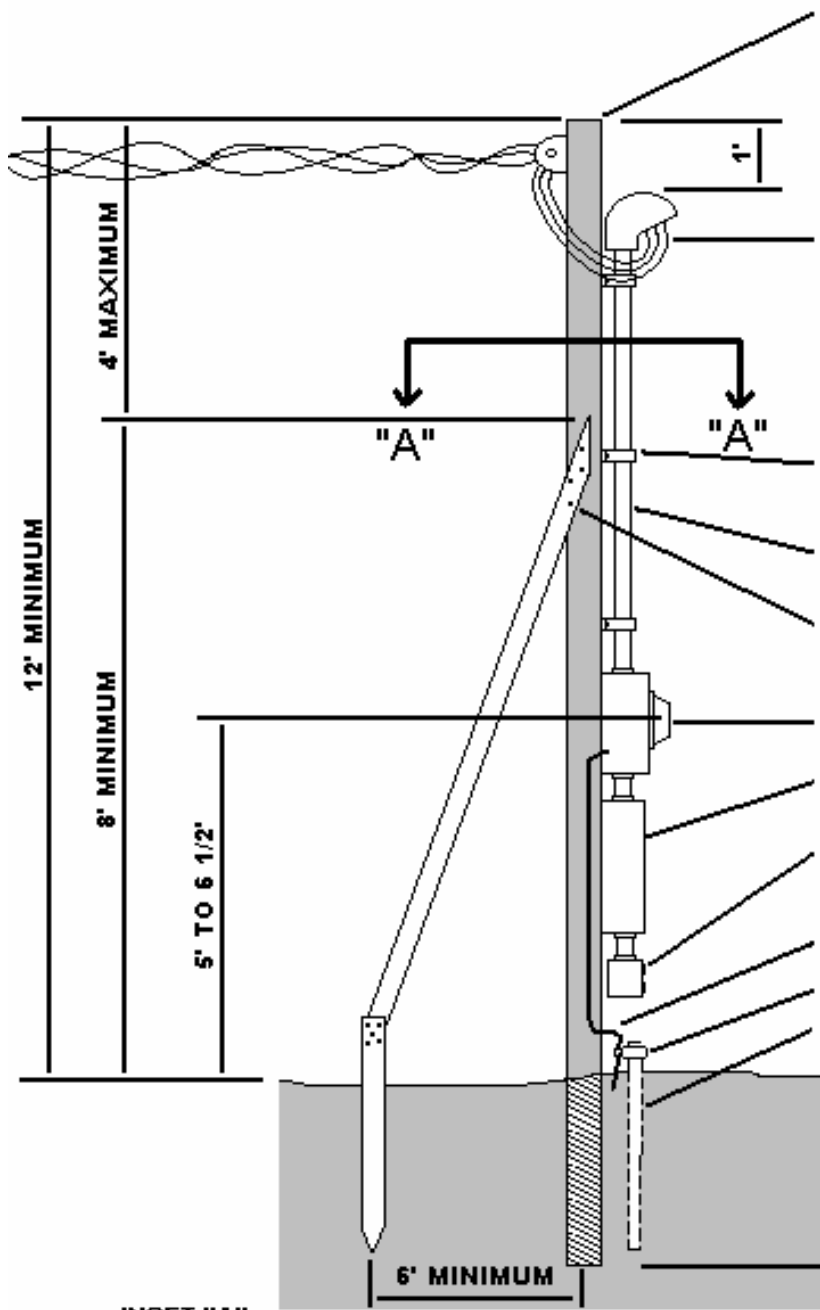

16' PINE POLE, CREOSOTED OR PENTA TREATED WITH 4" MIN. DIAMETER TOP OR 3 1/2" SQUARE POST.

MIN. 3-#6 CU. OR 3-#4 AL. U.L. APPROVED CONDUCTORS; BLACK INSULATED AND ONE WHITE OR MARKED NEUTRAL CONDUCTOR. A MINIMUM 2' OF WIRE SHOULD EXTEND FROM THE WEATHERHEAD.

CONDUIT STRAPS SHOULD BE SEPARATED NO MORE THAN 30" WITH A MINIMUM OF THREE STRAPS. USE LAG SCREWS FOR ATTACHMENT TO POLE.

REFER TO NEC FOR CONDUIT SIZES.


2" x 4" BRACES ATTACHED WITH LAG SCREWS OR 16 PENNY NAILS.

METER SOCKET FURNISHED BY DETEC

RAINTIGHT BREAKER BOX  
RECEPTACLES SHALL HAVE APPROVED GROUND FAULT PROTECTION PER NEC OR GFI. THESE TYPE BREAKERS ARE TO BE INSTALLED.

GROUND WIRE, MIN. #6 CU.  
APPROVED GROUND CLAMP  
GROUND ROD

**INSET "A"**

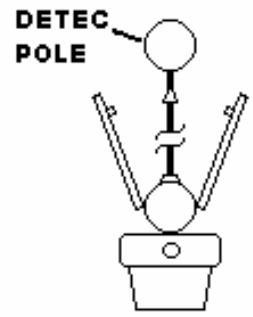

BRACE IN THE DIRECTION OF DETEC POLE

NOTES:  
MINIMUM REQUIREMENTS ONLY ARE SHOWN ON THIS STANDARD AND ARE NOT INTENDED TO CONFLICT WITH ANY LOCAL CODE WHICH MAY REQUIRE MORE THAN INDICATED

DEEP EAST TEXAS ELECTRIC COOPERATIVE, INC. SAN AUGUSTINE, TEXAS		
<b>TEMPORARY METER POLE SIX MONTH LIMIT</b>		
CORNELIUS-PIERCE CONSULTING ENGINEERS, INC.		
DWN. BY: D.A.N.	CKD. BY: J.T.C.	SCALE NONE
ENGRS FILE NO.	DATE: SEPT. 96	